



PLAN VIEW  
(LID OMITTED)

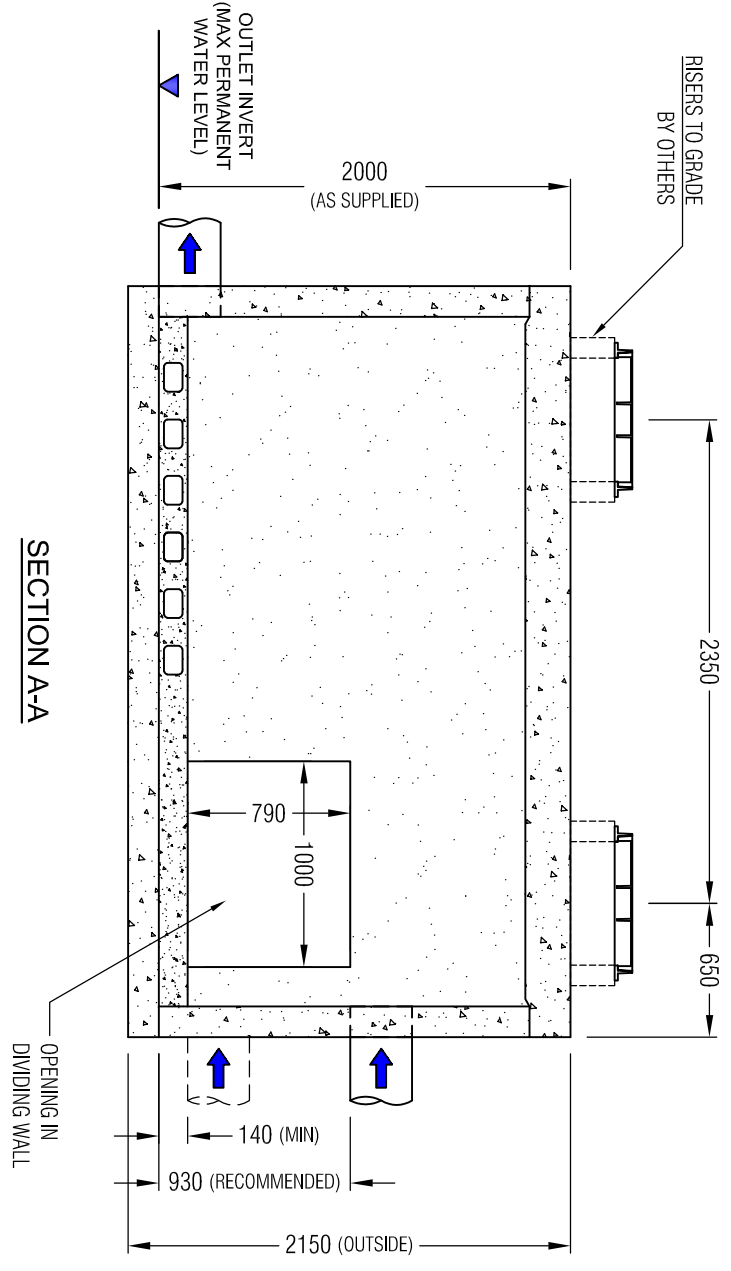

SECTION A-A

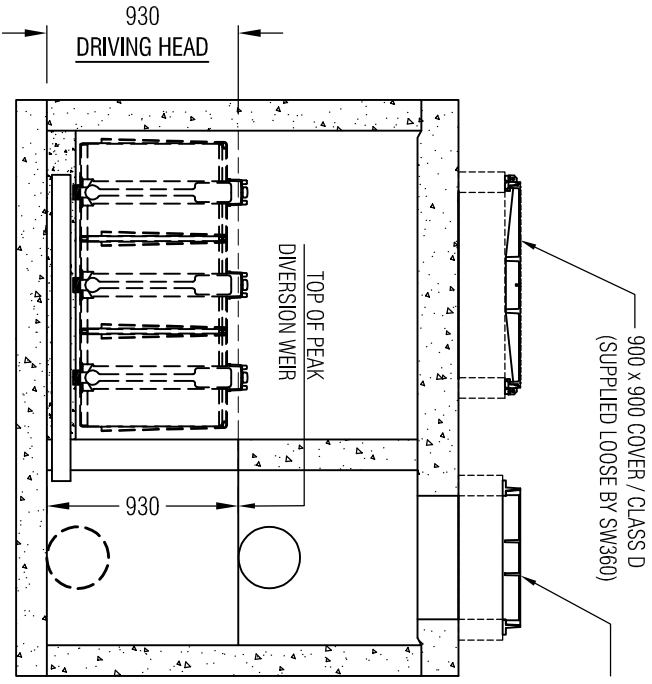

SECTION B-B

**TO BE COMPLETED BY CUSTOMER / CONTRACTOR**

COMPANY :	P.O. NUMBER :		
SITE ADDRESS :			
SITE CONTACT & PHONE :			
PREFERRED DELIVERY DATE (TBC SW360) :			
STORMFILTER REFERENCE (IF APPLICABLE) :			
INLET PIPE Ø :	PIPE MATERIAL :	CORE DRILL Ø :	INLET (IL) :
OUTLET PIPE Ø :	PIPE MATERIAL :	CORE DRILL Ø :	OUTLET (IL) :
LID LEVEL (RL) :	DTI :		
COMPLETED BY :	SIGNED :	DATE :	

**TO BE COMPLETED BY SW360**

SW360 PRODUCT CODE :	PERLITE	ZPG	OTHER :
MEDIA TYPE (CIRCLE ONE) :			PRE-INSTALLATION (Y/N) :
CARTRIDGE QTY (STATE) :			
SP FLOW RATE (CIRCLE ONE) :	FULL (Ø 27.6 ID)	3 QTR (Ø 24.0 ID)	HALF (Ø 19.7 ID) OTHER :
ACCESS COVERS (CIRCLE ONE) :	BLACKMUSTARD	WHITE/OPAL	GREEN
COMPLETED BY :	SIGNED :	DATE :	

**APPROX WEIGHTS**

VAULT WEIGHT: **15700 Kg** (EMPTY)  
 VAULT WEIGHT: **16500 Kg** (WITH 16 x ZPG CARTIS FITTED)  
 LID WEIGHT: **4700 Kg**

**NOTES**

1. SW360 TO CONFIRM WEIGHTS AND LIFTING DETAILS PRIOR TO DELIVERY.
2. UNIT SUPPLIED WITH INLET & OUTLET HOLES PRE-CORED.
3. INLET AND OUTLET PIPES BY OTHERS.
4. SEALING / GROUTING OF CONCRETE LID AND PIPES BY CONTRACTOR, ENSURING LOCAL CODES AND REGULATIONS ARE COMPLIED WITH.
5. RISERS REQUIRED FROM VAULT LID TO ACCESS COVERS (FINISHED SURFACE LEVEL) SUPPLIED BY THE CONTRACTOR. CONTACT **0800STORMWATER** FOR RECOMMENDATIONS.
6. CONTRACTOR TO TAKE APPROPRIATE MEASURES TO PROTECT CARTRIDGES FROM CONSTRUCTION RELATED EROSION RUNOFF.
7. BACKFILL, BEDDING AND BUOYANCY DESIGN BY ENGINEER OF RECORD.
8. QTY OF CARTRIDGES BY ENGINEER OF RECORD.
9. CONCRETE VAULT AND LID DESIGNED AND MANUFACTURED TO HN-HO-72
10. DESIGN CHECK REQUIRED WHEN COVER ABOVE LID EXCEEDS 1.0M
11. OTHER CONFIGURATIONS ARE POSSIBLE. FOR REQUIREMENTS OUTSIDE OF DRAWING SPECIFICATIONS PLEASE CONTACT **0800STORMWATER**.



0800 STORMWATER  
 sales@stormwater360.co.nz  
 www.stormwater360.co.nz

STORMFILTER@ PEAK DIVERSION  
 OFF-LINE CARTRIDGE FILTRATION SYSTEM  
 16 x 69cm CART PD VAULT (RIGHT INLET)  
 GENERAL ARRANGEMENT

SCALE : N.T.S.	DRG No :	REV : 1	DATE : 27/03/20	JOB NO :	REV	REVISION DETAIL	DATE
	SF-VPD-69-3425-R-20				1	WEIGHTS ADDED	27/03/20
					0	APPROVED	17/03/20