

**TO BE COMPLETED BY CUSTOMER / CONTRACTOR**


COMPANY :				P.O. NUMBER :	
SITE ADDRESS :					
SITE CONTACT & PHONE :					
PREFERRED DELIVERY DATE (TBC SW360) :					
STORMFILTER REFERENCE (IF APPLICABLE) :					
INLET PIPE Ø :	PIPE MATERIAL :	CORE DRILL Ø :	INLET (IL) :		
OUTLET PIPE Ø :	PIPE MATERIAL :	CORE DRILL Ø :	OUTLET (IL) :		
LID LEVEL (RL) :	DTI :				
COMPLETED BY :	SIGNED :	DATE :			

**TO BE COMPLETED BY SW360**


SW360 PRODUCT CODE :					
MEDIA TYPE (CIRCLE ONE) :	PERLITE	ZPG	OTHER :		
CARTRIDGE QTY (STATE) :					
SP FLOW RATE (CIRCLE ONE) :	FULL (Ø 27.6 ID)	3 QTR (Ø 24.0 ID)	HALF (Ø 19.7 ID)	OTHER :	
ACCESS COVERS (CIRCLE ONE) :	BLACKMUSTARD	WHITE/OPAL	GREEN	OTHER :	
COMPLETED BY :	SIGNED :	DATE :	OTHER :		

**APPROX WEIGHTS**


VAULT WEIGHT: **18500 Kg (EMPTY)**  
 VAULT WEIGHT: **19650 Kg (WITH 23 x ZPG CARTS FITTED)**  
 LID WEIGHT: **6000 Kg**

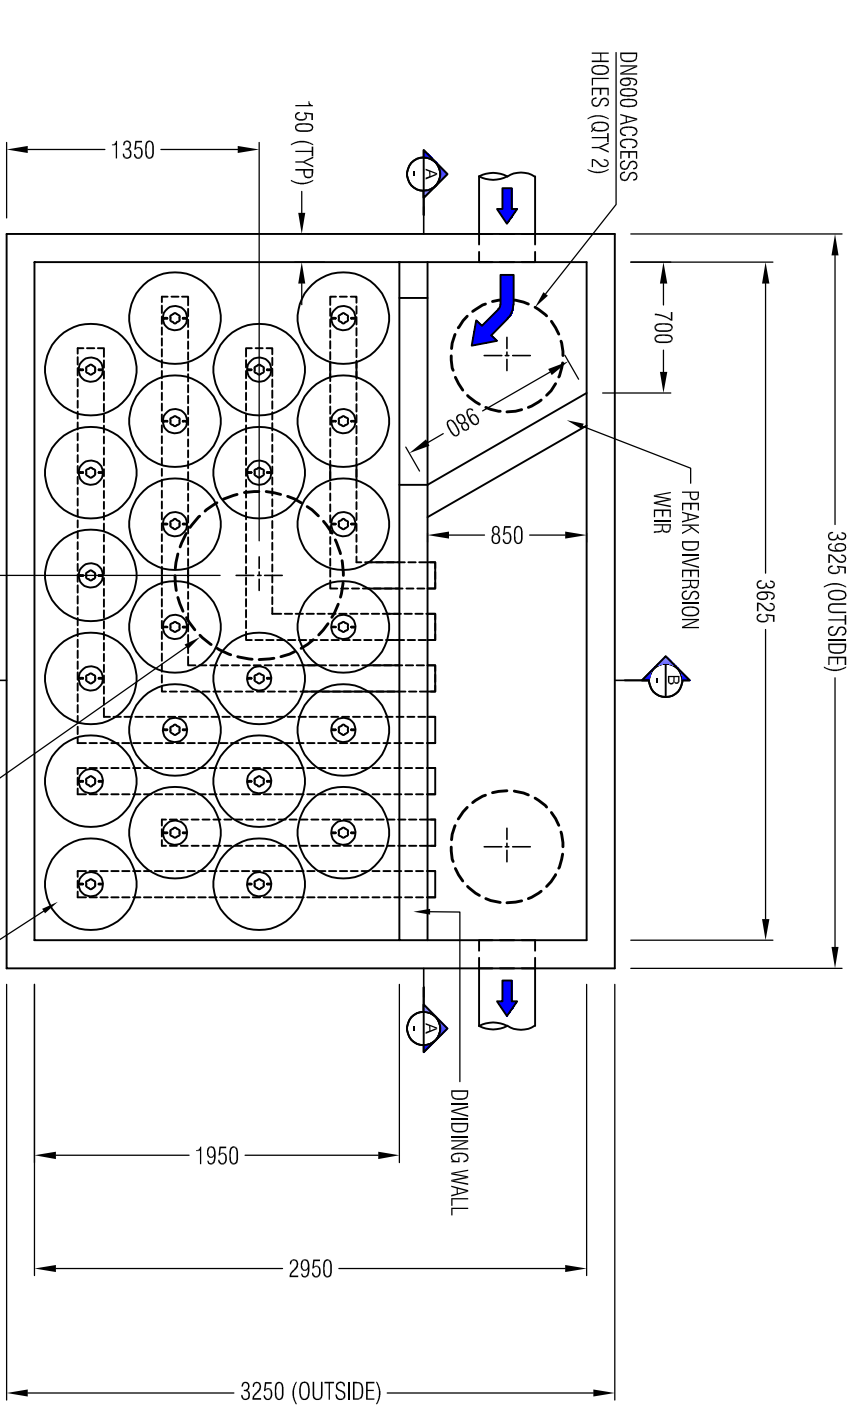

PLAN VIEW (LID OMITTED)

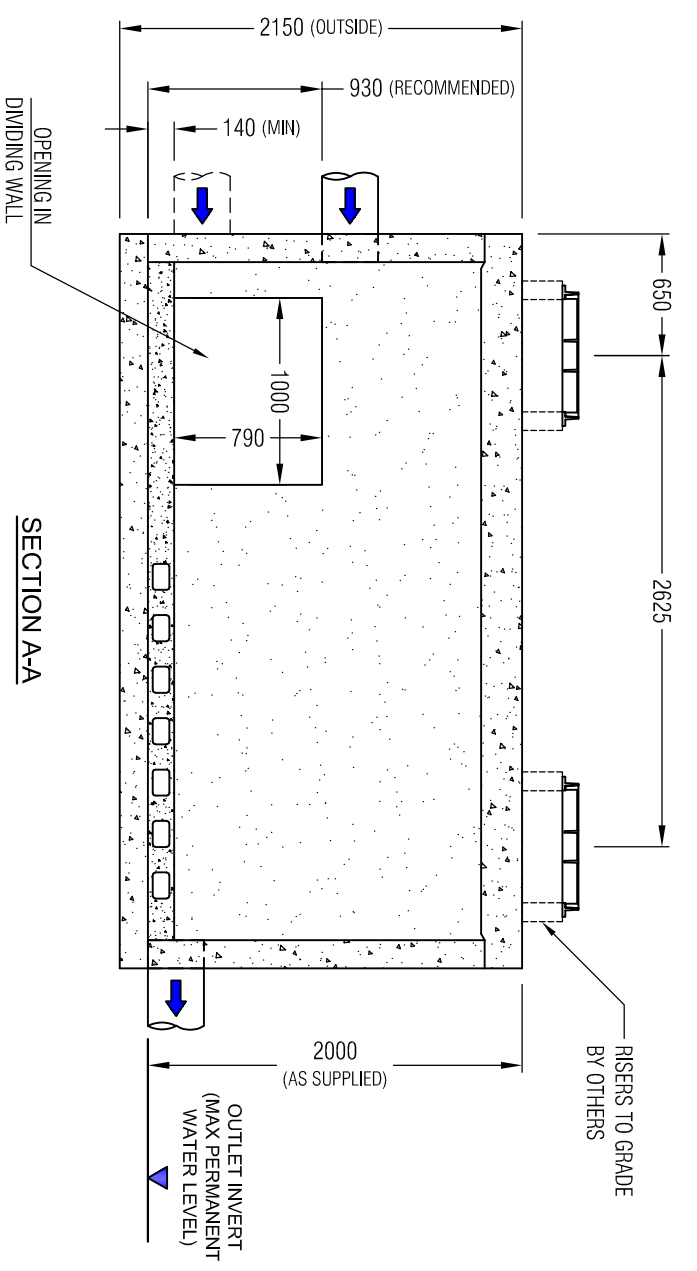

SECTION A-A

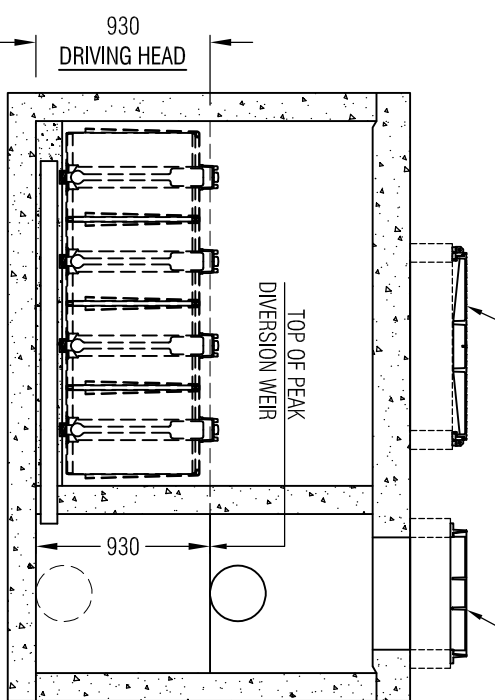

SECTION B-B

**NOTES**

- SW360 TO CONFIRM WEIGHTS AND LIFTING DETAILS PRIOR TO DELIVERY.
- UNIT SUPPLIED WITH INLET & OUTLET HOLES PRE-CORED.
- INLET AND OUTLET PIPES BY OTHERS.
- SEALING / GROUTING OF CONCRETE LID AND PIPES BY CONTRACTOR, ENSURING LOCAL CODES AND REGULATIONS ARE COMPLIED WITH.
- RISERS REQUIRED FROM VAULT LID TO ACCESS COVERS (FINISHED SURFACE LEVEL) SUPPLIED BY THE CONTRACTOR. CONTACT **0800STORMWATER** FOR RECOMMENDATIONS.
- CONTRACTOR TO TAKE APPROPRIATE MEASURES TO PROTECT CARTRIDGES FROM CONSTRUCTION RELATED EROSION RUNOFF.
- BACKFILL, BEDDING AND BUOYANCY DESIGN BY ENGINEER OF RECORD.
- QTY OF CARTRIDGES BY ENGINEER OF RECORD.
- CONCRETE VAULT AND LID DESIGNED AND MANUFACTURED TO HN-HO-72
- DESIGN CHECK REQUIRED WHEN COVER ABOVE LID EXCEEDS 1.0M
- OTHER CONFIGURATIONS ARE POSSIBLE. FOR REQUIREMENTS OUTSIDE OF DRAWING SPECIFICATIONS PLEASE CONTACT **0800STORMWATER**.

**Stormwater360**  
 BETWEEN SKY AND SEA

0800 STORMWATER  
 sales@stormwater360.co.nz  
 www.stormwater360.co.nz

**CONDITION OF USE**  
 © STORMWATER360 2020  
 Any unauthorised reproduction of this drawing in part or in full is prohibited

STORMFILTER@ PEAK DIVERSION		JOB NO. :	REV	REVISION DETAIL	DATE
OFF-LINE CARTRIDGE FILTRATION SYSTEM		PROJECT :	1	WEIGHTS ADDED	27/03/20
23 x 69cm CART PD VAULT (LEFT INLET)		DRN :	0	APPROVED	17/03/20
GENERAL ARRANGEMENT		G.S. :			
SCALE : N.T.S.	DRG No. :	REV. :	DATE :	CKD :	
	SF-VPD-69-3630-L-20	1	27/03/20	K.J.	17/03/20