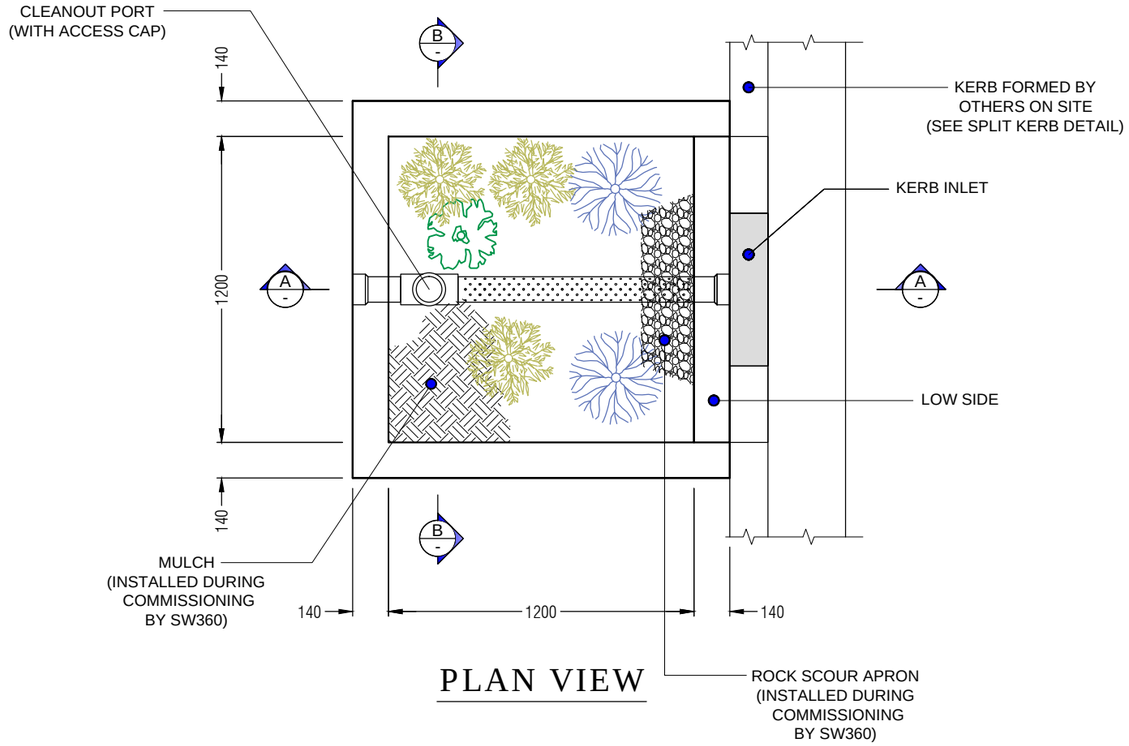

PLAN VIEW

NOTES :

1. BACKFILL, BEDDING AND BUOYANCY DESIGN BY ENGINEER OF RECORD.
2. FILTERRA©UNIT FITTED WITH SWIFTLIFT OR HAIRPIN LIFTING POINTS. SPREADER BARS REQUIRED TO AVOID DAMAGE TO CONCRETE EDGES DURING OFF-LOADING.
3. TO PROTECT MEDIA FROM CONSTRUCTION RELATED EROSION RUNOFF, FILTERRA © UNIT IS DELIVERED WITH BOXING OVER MEDIA. BOXING TO BE REMOVED **ONLY** BY STORMWATER360© DURING COMMISSIONING.
4. MULCH, PLANTING AND ROCK SCOUR TO BE INSTALLED DURING COMMISSIONING BY STORMWATER360©. COMMISSIONING TO OCCUR ONLY WHEN PAVEMENT IS INSTALLED, AND SITE IS CLEAN.
5. PLANT SELECTION BY OTHERS BASED ON STORMWATER360 ©PLANT GUIDE.
6. CALL **0800STORMWATER** FOR COMMISSIONING.
7. OVERFLOW BYPASS CATCH PIT TO BE INSTALLED DOWNSTREAM OF FILTERRA ©UNIT.
8. RECOMMENDED THAT FLEXIBLE COUPLINGS USED ON OUTLET TO ALLOW FOR POTENTIAL SETTLEMENT.
9. CONCRETE STRUCTURE DESIGNED TO HN-72.

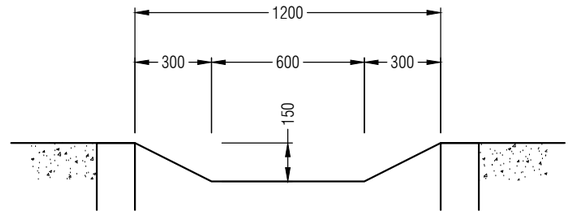

SPLIT KERB DETAIL

RECOMMENDATION ONLY
(BY OTHERS)

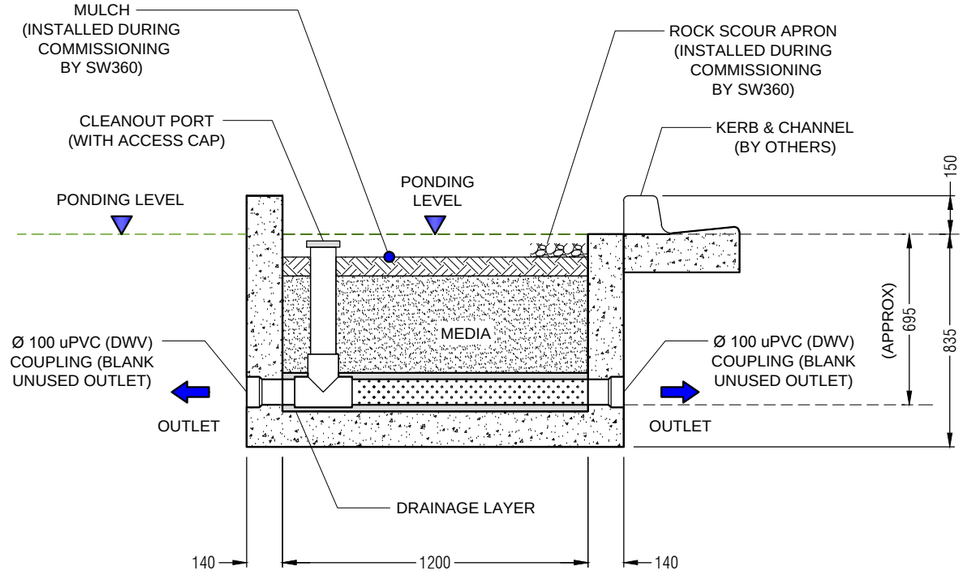

SECTION A-A

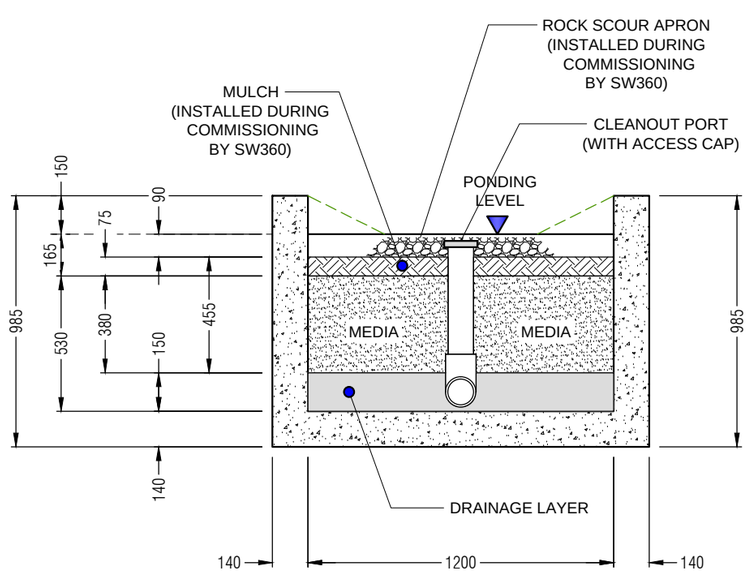

SECTION B-B

ESTIMATED WEIGHT :
CONCRETE VAULT + MEDIA
+ DRAINAGE LAYER
MASS = 4000 Kg

filterra®

THIS PRODUCT MAY BE PROTECTED BY ONE OR MORE OF THE FOLLOWING U.S. PATENTS: 6,277,274; 6,569,321; 7,625,485; 7,425,261; 7,833,412; RELATED FOREIGN PATENTS.

Stormwater360®
BETWEEN SKY AND SEA

0800 STORMWATER
sales@stormwater360.co.nz
www.stormwater360.co.nz

CONDITION OF USE

© STORMWATER360 2019
Any unauthorised reproduction of this drawing in part or in full is prohibited

FILTERRA®
STORMWATER BIOFILTRATION
OPEN TOP / SHALLOW DEPTH 1200 x 1200 (INSIDE)
GENERAL ARRANGEMENT

SCALE : NTS	DRG No : FT-OT-SH-1212-20	REV : 1	DATE : 04.02.19

JOB NO :		REV	REVISION DETAIL	DATE
PROJECT :		0	FIRST ISSUE	04.02.19
		1	DWG No. CHANGE	27.03.19
DRN :	R.P. 04.02.19			
CKD :	G.S. G.Y. 04.02.19			