



PLAN VIEW

- NOTES :**
1. BACKFILL, BEDDING AND BUOYANCY DESIGN BY ENGINEER OF RECORD.
 2. FILTERRA® UNIT FITTED WITH SWIFTLIFT OR HAIRPIN LIFTING POINTS. SPREADER BARS REQUIRED TO AVOID DAMAGE TO CONCRETE EDGES DURING OFF-LOADING.
 3. TO PROTECT MEDIA FROM CONSTRUCTION RELATED EROSION RUNOFF, FILTERRA® UNIT IS DELIVERED WITH BOXING OVER MEDIA. BOXING TO BE REMOVED **ONLY** BY STORMWATER360® DURING COMMISSIONING.
 4. MULCH, PLANTING AND ROCK SCOUR TO BE INSTALLED DURING COMMISSIONING BY STORMWATER360®. COMMISSIONING TO OCCUR ONLY WHEN PAVEMENT IS INSTALLED, AND SITE IS CLEAN.
 5. PLANT SELECTION BY OTHERS BASED ON STORMWATER360® PLANT GUIDE.
 6. CALL **0800STORMWATER** FOR COMMISSIONING.
 7. OVERFLOW BYPASS CATCH PIT TO BE INSTALLED DOWNSTREAM OF FILTERRA® UNIT.
 8. RECOMMENDED THAT FLEXIBLE COUPLINGS USED ON OUTLET TO ALLOW FOR POTENTIAL SETTLEMENT.
 9. CONCRETE STRUCTURE DESIGNED TO HN-72.

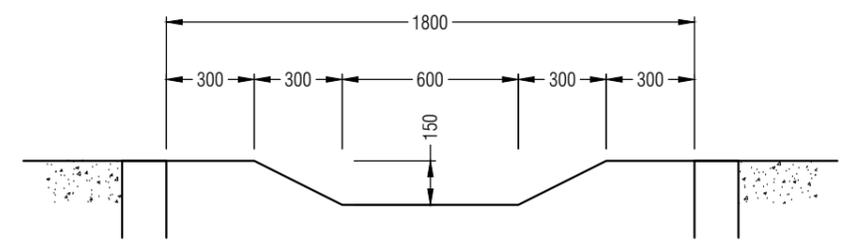


SPLIT KERB DETAIL

RECOMMENDATION ONLY
(BY OTHERS)

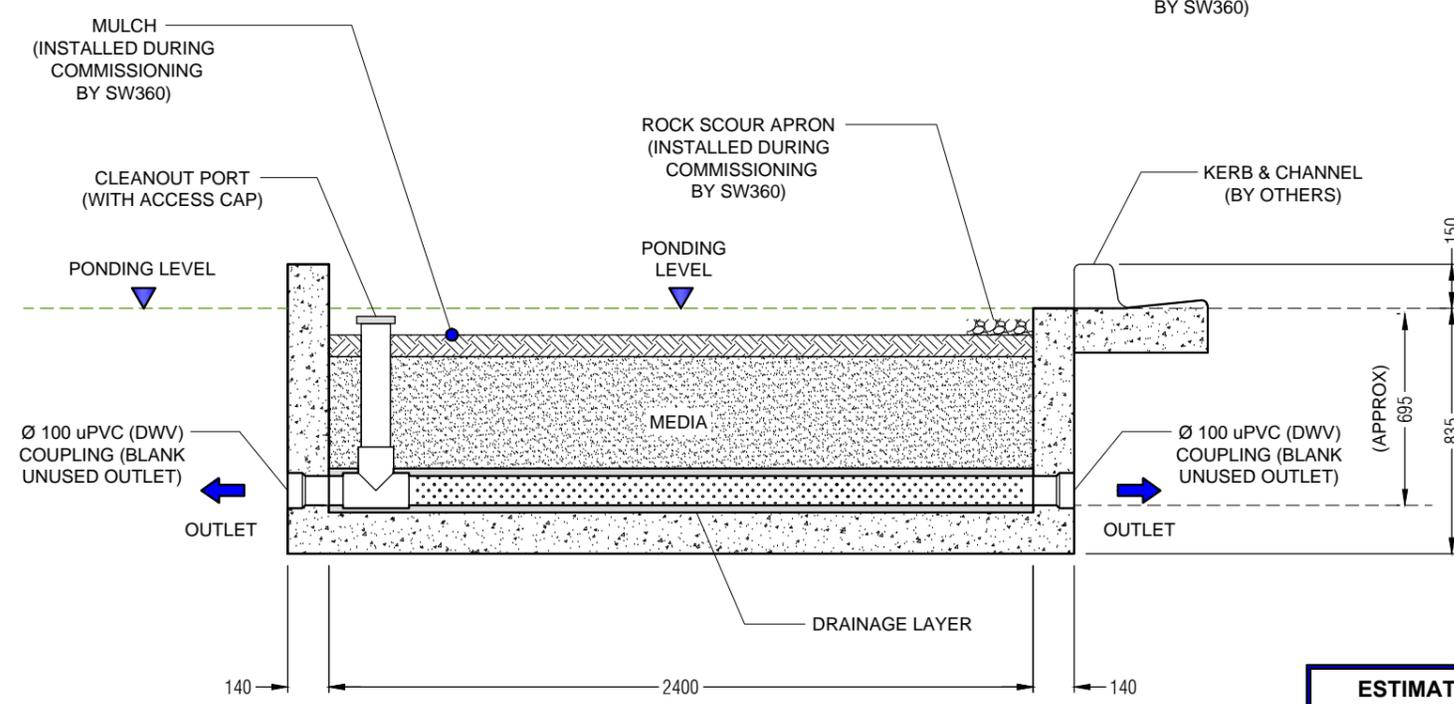

SECTION A-A

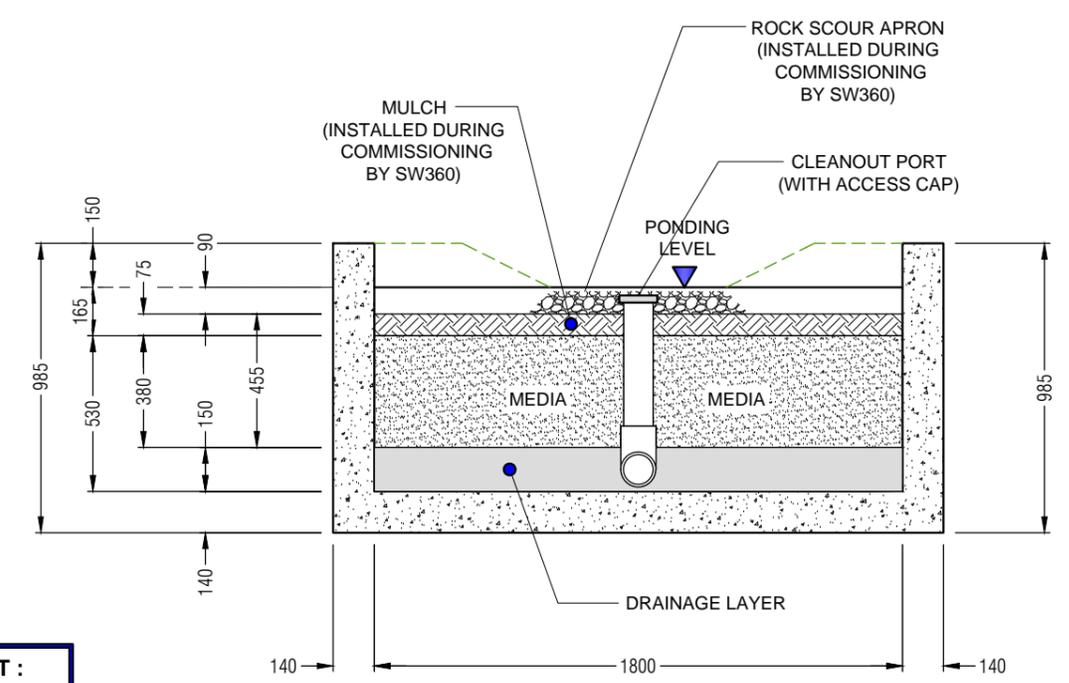

SECTION B-B

ESTIMATED WEIGHT :
CONCRETE VAULT + MEDIA
+ DRAINAGE LAYER
MASS = 9300 Kg



THIS PRODUCT MAY BE PROTECTED BY ONE OR MORE OF THE FOLLOWING U.S. PATENTS: 6,277,274; 6,569,321; 7,625,485; 7,425,261; 7,833,412. RELATED FOREIGN PATENTS.



0800 STORMWATER
sales@stormwater360.co.nz
www.stormwater360.co.nz

CONDITION OF USE
© STORMWATER360 2019
Any unauthorised reproduction of this drawing in part or in full is prohibited

FILTERRA®
STORMWATER BIOFILTRATION
OPEN TOP / SHALLOW DEPTH 1800 x 2400 (INSIDE)
GENERAL ARRANGEMENT

SCALE : NTS DRG No : FT-OT-SH-1824-20 REV : 1 DATE : 04.02.19

| JOB NO : | REV | REVISION DETAIL | DATE |
|-----------|------|-----------------|----------|
| PROJECT : | 0 | FIRST ISSUE | 04.02.19 |
| DRN : | 1 | DWG No. CHANGE | 27.03.19 |
| CKD : | R.P. | G.Y. | 04.02.19 |
| | G.S. | G.Y. | 04.02.19 |