


TO BE COMPLETED BY CUSTOMER / CONTRACTOR						
COMPANY :				P.O. NUMBER :		
SITE ADDRESS :						
SITE CONTACT & PHONE :						
PREFERRED DELIVERY DATE (TBC SW360) :						
STORMFILTER REFERENCE (IF APPLICABLE) :						
<b>OUTLET HOLE Ø (CIRCLE) :</b> (TYPICAL PIPE MATERIAL)	<b>Ø 130</b> (DN100 PVC)	<b>Ø 200</b> (DN150 PVC)	<b>Ø 225</b> (DN175 PVC)	<b>Ø 275</b> (DN225 PVC)	<b>Ø 300</b> (DN225 RRJ)	<b>Ø 350</b> (DN300 PVC)
LID LEVEL (RL) :			OUTLET PIPE (IL) :		DTI :	
COMPLETED BY :			SIGNED :		DATE :	

TO BE COMPLETED BY SW360				
SW360 PRODUCT CODE :				
MEDIA TYPE (CIRCLE ONE) :	PERLITE	ZPG	OTHER :	
CARTRIDGE QTY (STATE) :				PRE-INSTALLATION (Y/N) :
SP FLOW RATE (CIRCLE ONE) :	FULL (Ø 27.6 ID) BLACK/MUSTARD	3 QTR (Ø 24.0 ID) WHITE/OPAL	HALF (Ø 19.7 ID) GREEN	OTHER :
ACCESS COVER (CIRCLE ONE) :	ALLOY CHEQUER PLATE			OTHER :
COMPLETED BY :	SIGNED :			DATE :

NOTE : INLET (MAX) AS SUCH THAT TOP OF CORED HOLE TO TOP OF RISER IS 300 mm MIN

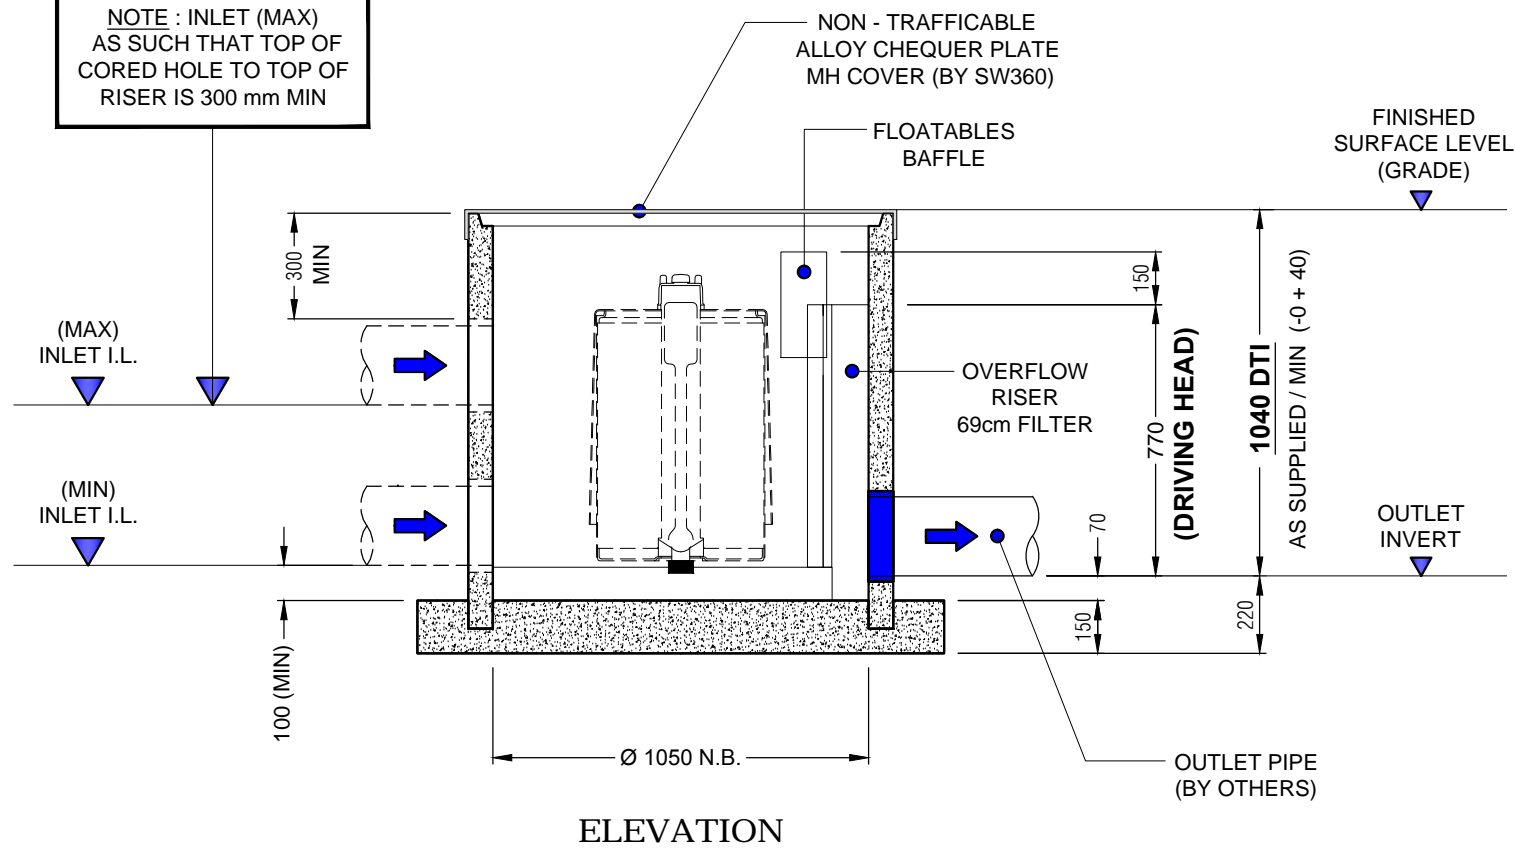

SW360 PRODUCTION DATA															
<b>OUTLET HOLE DETAILS :</b> (CIRCLE REQUIREMENT)															
	<table border="1"> <thead> <tr> <th>OUTLET HOLE Ø</th> <th>DIM A</th> </tr> </thead> <tbody> <tr> <td>130</td> <td>120</td> </tr> <tr> <td>200</td> <td>145</td> </tr> <tr> <td>225</td> <td>165</td> </tr> <tr> <td>275</td> <td>190</td> </tr> <tr> <td>300</td> <td>180</td> </tr> <tr> <td>350</td> <td>220</td> </tr> </tbody> </table>	OUTLET HOLE Ø	DIM A	130	120	200	145	225	165	275	190	300	180	350	220
OUTLET HOLE Ø	DIM A														
130	120														
200	145														
225	165														
275	190														
300	180														
350	220														
<b>DWG ISSUE No. :</b> <b>REQUIRED DATE :</b>															

- | NOTES  |
|--|
| 1. MANHOLE UNIT FITTED WITH SWIFTLIFT ANCHOR POINTS (QTY 2). DO NOT EXCEED 60 DEGREE LIFT ANGLE.                             |
| 2. UNIT SUPPLIED WITH OUTLET CORE DRILLED. INLET/S CORE DRILLED ON SITE BY OTHERS WITHIN RANGE SHOWN ON DRAWING.             |
| 3. SEALING / GROUTING OF MANHOLE COMPONENTS AND PIPES BY CONTRACTOR. ENSURING LOCAL CODES AND REGULATIONS ARE COMPLIED WITH. |
| 4. ANY RISERS REQUIRED TO INCREASE THE DEPTH TO INVERT (DTI) FROM THAT AS DRAWN TO BE SUPPLIED BY THE CONTRACTOR.            |
| 5. FOR A DTI EXCEEDING 5m PLEASE CONTACT <b>0800STORMWATER</b> .   |
| 6. CONTRACTOR TO TAKE APPROPRIATE MEASURES TO PROTECT CARTRIDGES FROM CONSTRUCTION RELATED EROSION RUNOFF.                   |
| 7. BACKFILL, BEDDING AND BUOYANCY DESIGN BY ENGINEER OF RECORD   |
| 8. QTY OF CARTRIDGES BY ENGINEER OF RECORD.  |
| 9. CONCRETE MANHOLE RISERS ARE DESIGNED AND MANUFACTURED IN ACCORDANCE WITH AS/NZS 4058 : 2007                               |
| 10. CONCRETE MANHOLE BASES ARE DESIGNED AND MANUFACTURED IN ACCORDANCE WITH NZS 3101 : 2006 & NZS 3109 : 1997                |
| 11. ALUMINIUM LID / NON-TRAFFICABLE  |
| 12. FOR REQUIREMENTS OUTSIDE OF DRAWING SPECIFICATIONS PLEASE CONTACT <b>0800STORMWATER</b> .                                |

APPROX WEIGHTS
MANHOLE SECTION INCLUDING CARTRIDGES : <b>1400 Kg</b> (AS DELIVERED, BASED ON QTY 1 ZPG CARTS)