


**PLAN**  
(ACCESS COVER AND LID REMOVED)

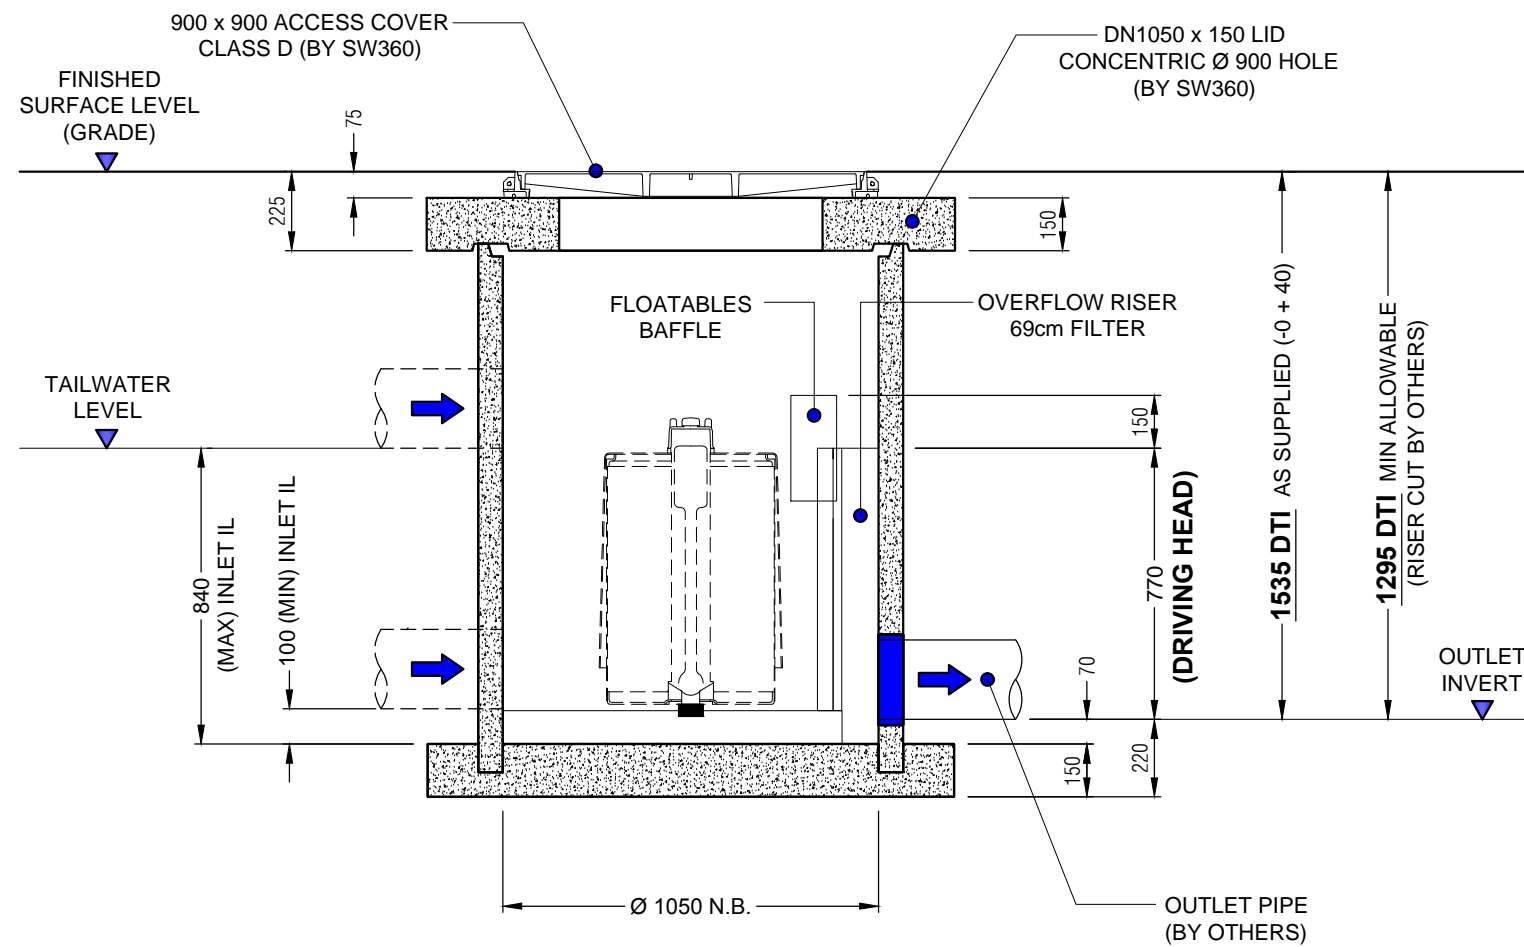

**ELEVATION**

TO BE COMPLETED BY CUSTOMER / CONTRACTOR						
COMPANY :			P.O. NUMBER :			
SITE ADDRESS :						
SITE CONTACT & PHONE :						
PREFERRED DELIVERY DATE (TBC SW360) :						
STORMFILTER REFERENCE (IF APPLICABLE) :						
<b>OUTLET HOLE Ø (CIRCLE) :</b> (TYPICAL PIPE MATERIAL)	<b>Ø 130</b> (DN100 PVC)	<b>Ø 200</b> (DN150 PVC)	<b>Ø 225</b> (DN175 PVC)	<b>Ø 275</b> (DN225 PVC)	<b>Ø 300</b> (DN225 RRJ)	<b>Ø 350</b> (DN300 PVC)
LID LEVEL (RL) :			OUTLET PIPE (IL) :		DTI :	
COMPLETED BY :			SIGNED :		DATE :	

TO BE COMPLETED BY SW360				
SW360 PRODUCT CODE :				
MEDIA TYPE (CIRCLE ONE) :	PERLITE	ZPG	OTHER :	
CARTRIDGE QTY (STATE) :				PRE-INSTALLATION (Y/N) :
SP FLOW RATE (CIRCLE ONE) :	FULL (Ø 27.6 ID) BLACK/MUSTARD	3 QTR (Ø 24.0 ID) WHITE/OPAL	HALF (Ø 19.7 ID) GREEN	OTHER :
ACCESS COVER (CIRCLE ONE) :	900 x 900 WEB-FORGE / CLASS D			OTHER :
COMPLETED BY :	SIGNED :			DATE :

**SW360 PRODUCTION DATA**

**OUTLET HOLE DETAILS :**  
(CIRCLE REQUIREMENT)

OUTLET HOLE Ø	DIM A
130	120
200	145
225	165
275	190
300	180
350	220

DWG ISSUE No. : \_\_\_\_\_

REQUIRED DATE : \_\_\_\_\_

- NOTES**
- MANHOLE UNIT FITTED WITH SWIFTLIFT ANCHOR POINTS (QTY 2). DO NOT EXCEED 60 DEGREE LIFT ANGLE. CONCRETE LID FITTED WITH SWIFTLIFT ANCHOR POINTS (QTY 4).
  - UNIT SUPPLIED WITH OUTLET CORE DRILLED. INLET/S CORE DRILLED ON SITE BY OTHERS WITHIN RANGE SHOWN ON DRAWING.
  - SEALING / GROUTING OF MANHOLE COMPONENTS AND PIPES BY CONTRACTOR. ENSURING LOCAL CODES AND REGULATIONS ARE COMPLIED WITH.
  - ANY RISERS REQUIRED TO INCREASE THE DEPTH TO INVERT (DTI) FROM THAT AS DRAWN TO BE SUPPLIED BY THE CONTRACTOR.
  - FOR A DTI EXCEEDING 5m PLEASE CONTACT **0800STORMWATER**.
  - CONTRACTOR TO TAKE APPROPRIATE MEASURES TO PROTECT CARTRIDGES FROM CONSTRUCTION RELATED EROSION RUNOFF.
  - BACKFILL, BEDDING AND BUOYANCY DESIGN BY ENGINEER OF RECORD
  - QTY OF CARTRIDGES BY ENGINEER OF RECORD.
  - CONCRETE MANHOLE RISERS ARE DESIGNED AND MANUFACTURED IN ACCORDANCE WITH AS/NZS 4058 : 2007
  - CONCRETE MANHOLE BASES ARE DESIGNED AND MANUFACTURED IN ACCORDANCE WITH NZS 3101 : 2006 & NZS 3109 : 1997
  - CONCRETE LID DESIGNED AND MANUFACTURED TO HN-HO-72
  - FOR REQUIREMENTS OUTSIDE OF DRAWING SPECIFICATIONS PLEASE CONTACT **0800STORMWATER**.

**APPROX WEIGHTS**

MANHOLE SECTION INCLUDING CARTRIDGES : **1600 Kg**  
(AS DELIVERED, BASED ON QTY 1 ZPG CARTS)

LID WEIGHT : **500 Kg**