


PLAN
(ACCESS COVER AND LID REMOVED)

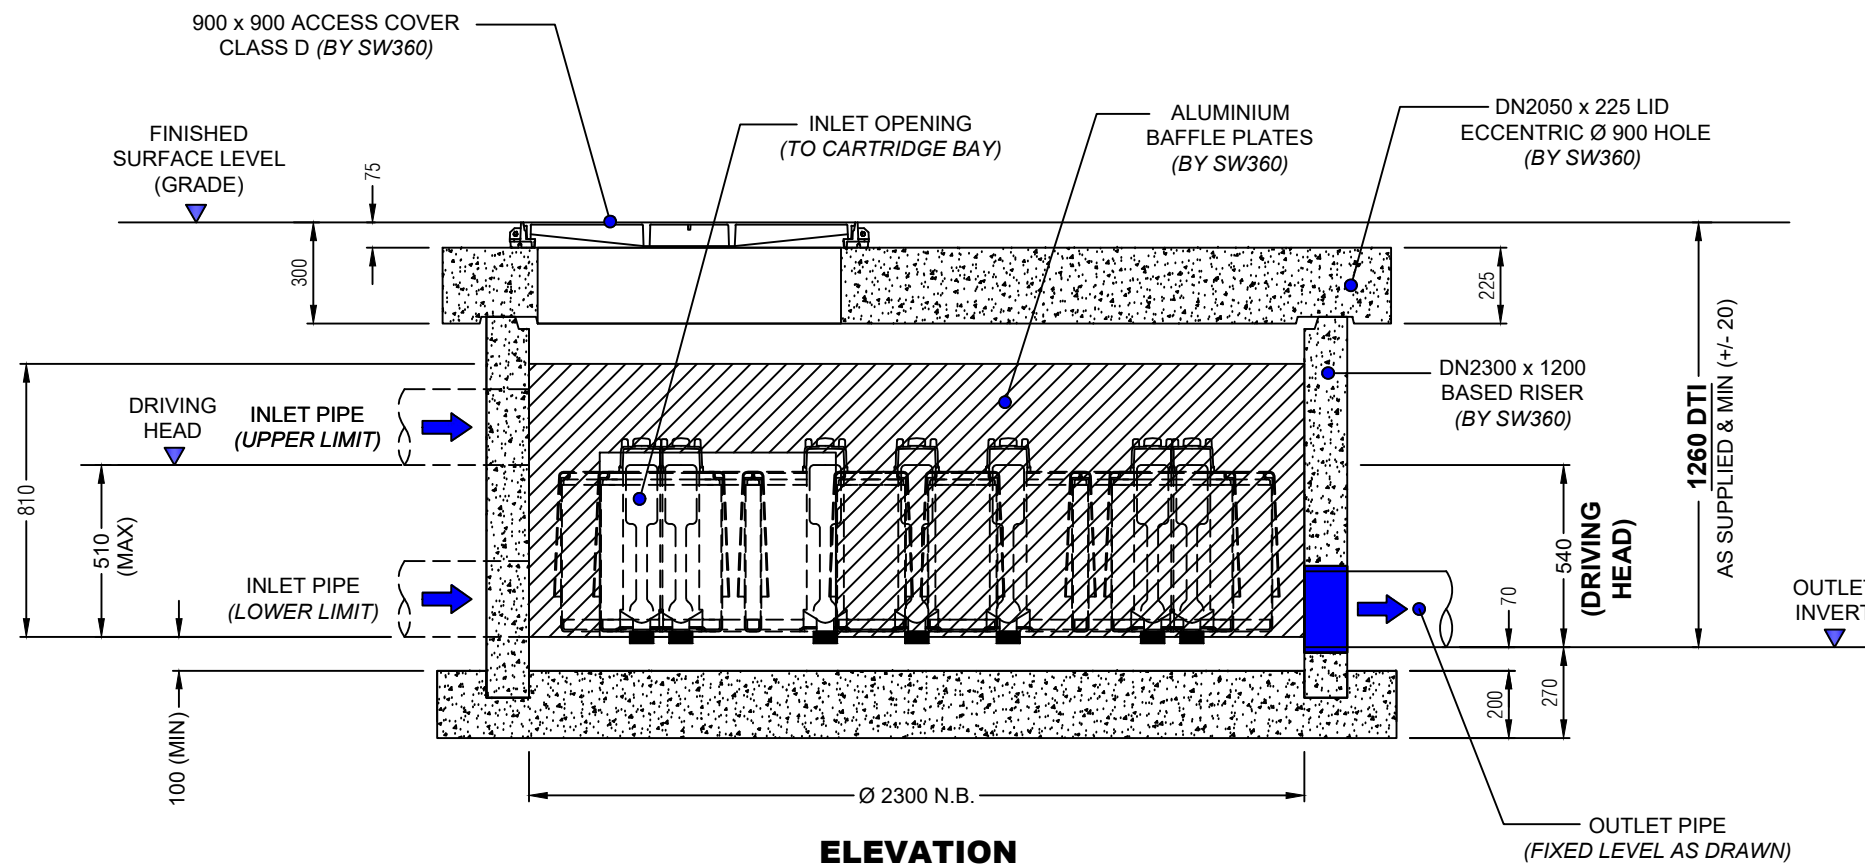

ELEVATION

TO BE COMPLETED BY CUSTOMER / CONTRACTOR

COMPANY :		P.O. NUMBER :	
SITE ADDRESS :			
SITE CONTACT & PHONE :			
PREFERRED DELIVERY DATE (TBC SW360) :			
STORMFILTER REFERENCE (IF APPLICABLE) :			
INLET PIPE Ø : DN450 RCRRJ - MAX DN475 PVC - MAX	PIPE MATERIAL : (PVC OR RCRRJ)	CORE DRILL Ø :	INLET (IL) :
OUTLET PIPE Ø : DN450 RCRRJ - MAX DN475 PVC - MAX	PIPE MATERIAL : (PVC OR RCRRJ)	CORE DRILL Ø :	OUTLET (IL) :
LID LEVEL (RL) :	DTI :	ORIENTATION : 180° (AS DRAWN) / 90° / 135°	
COMPLETED BY :		SIGNED :	DATE :

TO BE COMPLETED BY SW360

SW360 PRODUCT CODE :				
MEDIA TYPE (CIRCLE ONE) :	PERLITE	ZPG	OTHER :	
CARTRIDGE QTY (STATE) :				PRE-INSTALLATION (Y/N) :
SP FLOW RATE (CIRCLE ONE) :	FULL (Ø 25.0 ID) RED	3 QTR (Ø 21.8 ID) GREY	HALF (Ø 17.9 ID) ORANGE	OTHER :
ACCESS COVER (CIRCLE ONE) :	900 x 900 WEB-FORGE / CLASS D			OTHER :
COMPLETED BY :	SIGNED :	DATE :		

NOTES

- MANHOLE AND LID FITTED WITH SWIFT-LIFT ANCHOR POINTS.
- UNIT SUPPLIED WITH INLET & OUTLET CORE DRILLED.
- SEALING / GROUTING OF MANHOLE COMPONENTS AND PIPES BY CONTRACTOR. ENSURING LOCAL CODES AND REGULATIONS ARE COMPLIED WITH.
- ANY RISERS REQUIRED TO INCREASE THE DEPTH TO INVERT (DTI) FROM THAT AS DRAWN TO BE SUPPLIED BY THE CONTRACTOR.
- FOR A DTI EXCEEDING 5m PLEASE CONTACT **0800STORMWATER**.
- CONTRACTOR TO TAKE APPROPRIATE MEASURES TO PROTECT CARTRIDGES FROM CONSTRUCTION RELATED EROSION RUNOFF.
- BACKFILL, BEDDING AND BUOYANCY DESIGN BY ENGINEER OF RECORD
- QTY OF CARTRIDGES BY ENGINEER OF RECORD.
- CONCRETE MANHOLE RISERS ARE DESIGNED AND MANUFACTURED IN ACCORDANCE WITH AS/NZS 4058 : 2007
- CONCRETE MANHOLE BASES ARE DESIGNED AND MANUFACTURED IN ACCORDANCE WITH NZS 3101 : 2006 & NZS 3109 : 1997
- CONCRETE LID DESIGNED AND MANUFACTURED TO HN-HO-72
- FOR REQUIREMENTS OUTSIDE OF DRAWING SPECIFICATIONS PLEASE CONTACT **0800STORMWATER**.

APPROX WEIGHTS

MANHOLE SECTION INCLUDING CARTRIDGES : **8500 Kg**
(AS DELIVERED, BASED ON QTY 9 ZPG CARTS)
LID WEIGHT : **3480 Kg**



0800 STORMWATER
sales@stormwater360.co.nz
www.stormwater360.co.nz

CONDITION OF USE

© STORMWATER360 2019
Any unauthorised reproduction of this drawing in part or in full is prohibited

STORMFILTER® PEAK DIVERSION
OFF - LINE CARTRIDGE FILTRATION SYSTEM
46cm CART / DN2300 x 1200 MH - TRAFFICABLE
GENERAL ARRANGEMENT

SCALE : N.T.S. DRG No : SF-MHPD-46-2300-T-20 REV : 2 DATE : 13.02.20

JOB NO :		REV	REVISION DETAIL	DATE
PROJECT :		2	RISER CHANGE	13.02.20
		1	CORRECTION	20.06.19
DRN :	R.P.	22.05.19	0	APPROVED
CKD :	G.S.	22.05.19		