


PLAN

(ACCESS COVER AND LID REMOVED)

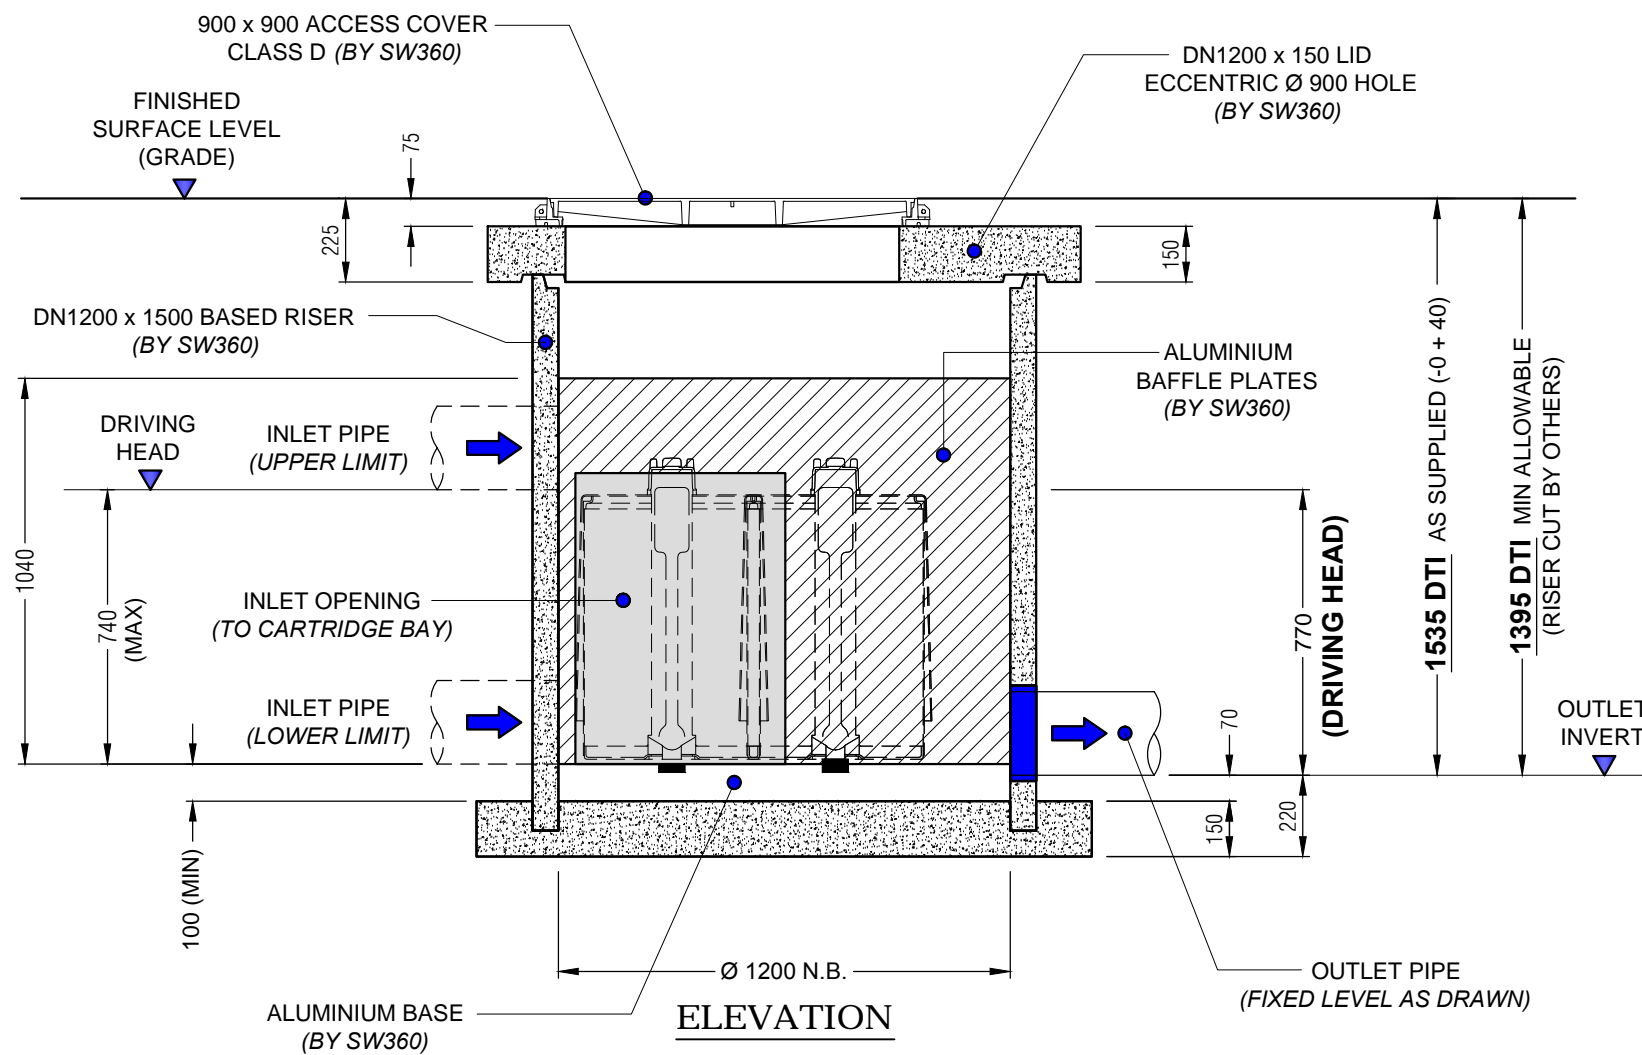

ELEVATION

TO BE COMPLETED BY CUSTOMER / CONTRACTOR

COMPANY :		P.O. NUMBER :	
SITE ADDRESS :			
SITE CONTACT & PHONE :			
PREFERRED DELIVERY DATE (TBC SW360) :			
STORMFILTER REFERENCE (IF APPLICABLE) :			
INLET PIPE Ø : DN225 RCRRJ - MAX DN300 PVC - MAX	PIPE MATERIAL : (PVC OR RCRRJ)	CORE DRILL Ø :	INLET (IL) :
OUTLET PIPE Ø : DN225 RCRRJ - MAX DN300 PVC - MAX	PIPE MATERIAL : (PVC OR RCRRJ)	CORE DRILL Ø :	OUTLET (IL) :
LID LEVEL (RL) :	DTI :	ORIENTATION : 180° (AS DRAWN) / 90° / 135°	
COMPLETED BY :		SIGNED :	DATE :

TO BE COMPLETED BY SW360

SW360 PRODUCT CODE :				
MEDIA TYPE (CIRCLE ONE) :	PERLITE	ZPG	OTHER :	
CARTRIDGE QTY (STATE) :				PRE-INSTALLATION (Y/N) :
SP FLOW RATE (CIRCLE ONE) :	FULL (Ø 27.6 ID) BLACK/MUSTARD	3 QTR (Ø 24.0 ID) WHITE/OPAL	HALF (Ø 19.7 ID) GREEN	OTHER :
ACCESS COVER (CIRCLE ONE) :	900 x 900 WEB-FORGE / CLASS D			OTHER :
COMPLETED BY :	SIGNED :			DATE :

NOTES

1. MANHOLE UNIT FITTED WITH 2 SWIFTLIFT ANCHOR POINTS. DO NOT EXCEED 60 DEGREE LIFT ANGLE. CONCRETE LID FITTED WITH 4 SWIFTLIFT ANCHOR POINTS.
2. UNIT SUPPLIED WITH INLET & OUTLET CORE DRILLED.
3. SEALING / GROUTING OF MANHOLE COMPONENTS AND PIPES BY CONTRACTOR. ENSURING LOCAL CODES AND REGULATIONS ARE COMPLIED WITH.
4. ANY RISERS REQUIRED TO INCREASE THE DEPTH TO INVERT (DTI) FROM THAT AS DRAWN TO BE SUPPLIED BY THE CONTRACTOR.
5. FOR A DTI EXCEEDING 5m PLEASE CONTACT **0800STORMWATER**.
6. CONTRACTOR TO TAKE APPROPRIATE MEASURES TO PROTECT CARTRIDGES FROM CONSTRUCTION RELATED EROSION RUNOFF.
7. BACKFILL, BEDDING AND BUOYANCY DESIGN BY ENGINEER OF RECORD
8. QTY OF CARTRIDGES BY ENGINEER OF RECORD.
9. CONCRETE MANHOLE RISERS ARE DESIGNED AND MANUFACTURED IN ACCORDANCE WITH AS/NZS 4058 : 2007
10. CONCRETE MANHOLE BASES ARE DESIGNED AND MANUFACTURED IN ACCORDANCE WITH NZS 3101 : 2006 & NZS 3109 : 1997
11. CONCRETE LID DESIGNED AND MANUFACTURED TO HN-HO-72
12. FOR REQUIREMENTS OUTSIDE OF DRAWING SPECIFICATIONS PLEASE CONTACT **0800STORMWATER**.

APPROX WEIGHTS

MANHOLE SECTION INCLUDING CARTRIDGES : **2050 Kg**
(AS DELIVERED, BASED ON QTY 2 ZPG CARTS)
LID WEIGHT : **520 Kg**



0800 STORMWATER
sales@stormwater360.co.nz
www.stormwater360.co.nz

CONDITION OF USE
© STORMWATER360 2019
Any unauthorised reproduction of this drawing in part or in full is prohibited

STORMFILTER® PEAK DIVERSION
OFF - LINE CARTRIDGE FILTRATION SYSTEM
69cm CART / DN1200 x 1500 MH - TRAFFICABLE
GENERAL ARRANGEMENT
SCALE : N.T.S. DRG No: SF-MHPD-69-1200-T-20 REV : 0 DATE : 22.05.19

JOB NO :		REV	REVISION DETAIL	DATE
PROJECT :		A	FOR APPROVAL	22.05.19
DRN :	R.P.	0	APPROVED	23.05.19
CKD :	G.S.			